

KOOLAIR

series

DF-49

Long-throw nozzles

ISO 9001

BUREAU VERITAS
Certification

Sistema de Gestión



www.koolair.com



CONTENTS

DF-49 jet nozzle	2
Dimensions	3
DF-49 selection table	4
Selection and correction charts	5
Selection example	14
Symbols	16

DF-49 long-throw nozzle



Description

The DF-49 combines long-throw efficiency with a more harmonious design. The stylised lines of the nozzles and the possibility of matching current decorative styles make these diffusers a reliable, great-looking component for facilities with more stringent requirements in terms of design and comfort.

Interior architecture are increasingly designing larger spaces for hotels, shopping malls, salons, convention centres, airport vestibules, passenger stations, social halls, etc.

In addition to effective air blowing at a long distance through nozzles (originally designed for industrial facilities), the use of these terminal units in more comfortable surroundings requires utmost attention to the aesthetic design.

The DF-49 long-throw nozzle and the decorative ring are manufactured in aluminium, with a standard paint finish in RAL 9010 white. The connection part is manufactured of galvanised steel sheet. The DF-49 nozzle has an extraordinarily good aesthetic design and can be painted by special order to fit any decorative need.

Application



The DF-49 nozzles provide long throws with a low noise level, releasing a long air jet with exceptional precision to a length of over 30 metres. They can be used for spot cooling and are especially appropriate for large rooms requiring a decorative look, for instance, large vestibules, nightclubs or entertainment areas, department stores, hotels, etc. The configuration allows the nozzle to swivel in all directions up to a maximum of $\pm 30^\circ$ in the horizontal or vertical direction.

Dimensions and mounting

The diffusers are attached by screws that are hidden by the decorative ring. See page 3.

Identification

Five sizes with manual swiveling. The motor drive swivels the nozzle in the vertical direction (up and down) at an angle of approximately $\pm 30^\circ$. For motor-driven operation one motor is required per nozzle, even in assemblies containing several units.

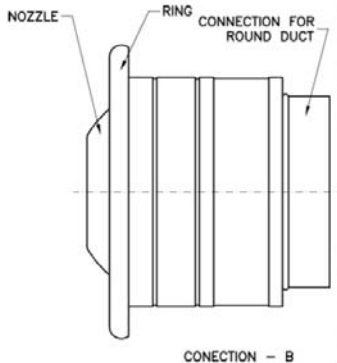

DF-49 Long-throw nozzles, manual operation.

A or B Connection system.

5, 8, 10, 12, 16, 20 Six sizes (see page 3).

AE Motor drive.
TR Thermostadjustable

AC Plenum or flan plate.
PAC Plenum box with connection to round duct.
PCL Integrated in plate to be adapted in round face duct.
INJ With "boot" to be installed in a round face duct.

DF-49 long-throw nozzle


Dimensions

Version A of the DF-49 jet nozzles can be mounted directly to the duct, plenum box or surface.

Version B allows a flexible duct of standard dimensions to be coupled directly to each nozzle.

In both cases, the nozzles are fixed by screws, which are housed below a decorative ring which can be removed by simple pressure.

In terms of the motor drive system, the motor may be placed inside or outside the unit, depending on the connection system and motor type (each case should be analysed separately). Please contact us for more information.

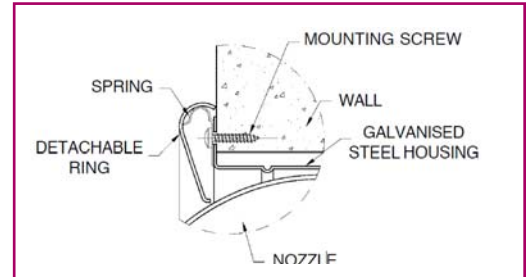

DIFFUSER	ϕA	ϕB	ϕC	D	ϕE	ϕF	G	H
5	55	135	155	21	99	209	63	106
8	90	208	225	34	159	268	100	144
10	123	257	275	48	199	317	132	202
12	155	314	330	56	249	376	132	224
16	220	417	440	78	399	511	156	236
20	290	493	510	100	399	584	173	265

$\phi C = \text{HOLE (Opening)}$

DIFFUSER	ϕC	ϕR	ϕS
5	160	152	182
8	230	222	252
10	282	274	304
12	335	329	359
16	445	436	494
20	517	508	536

$\phi C = \text{HOLE (Opening)}$

DF-49 selection table

Q		Size	5	8	10	12	16	20
(m³/h)	(l/s)	A _k (m²)	0,0025	0,0060	0,01262	0,0184	0,0390	0,0724
75	20,8	V _k (m/s)	8,3	3,5				
		X _{0,3} X _{0,5} X _{1,0} (m)	11,4 6,9 3,4	6,9 4,1 2,1				
		ΔP _t (Pa)	37	6				
		L _{WA} - dB(A)	<15	<15				
150	41,7	V _k (m/s)	16,6	6,9	3,3			
		X _{0,3} X _{0,5} X _{1,0} (m)	22,9 13,7 6,9	13,8 8,3 4,1	9,4 5,7 2,8			
		ΔP _t (Pa)	148	25	7			
		L _{WA} - dB(A)	34	<15	<15			
250	69,4	V _k (m/s)	27,7	11,5	5,5	3,8		
		X _{0,3} X _{0,5} X _{1,0} (m)	>30 22,9 11,4	22,9 13,8 6,9	15,7 9,4 4,7	12,9 7,8 3,9		
		ΔP _t (Pa)	411	69	19	7		
		L _{WA} - dB(A)	49	26	<15	<15		
500	138,9	V _k (m/s)		23,0	11,0	7,5	3,6	
		X _{0,3} X _{0,5} X _{1,0} (m)		>30 27,5 13,8	>30 18,9 9,4	25,9 15,5 7,8	17,3 10,4 5,2	
		ΔP _t (Pa)		274	75	28	6	
		L _{WA} - dB(A)		47	33	17	<15	
750	208,3	V _k (m/s)			16,5	11,3	5,3	
		X _{0,3} X _{0,5} X _{1,0} (m)			>30 28,3 14,1	>30 23,3 11,6	26,0 15,6 7,8	
		ΔP _t (Pa)			169	64	15	
		L _{WA} - dB(A)			47	29	<15	
1000	277,8	V _k (m/s)				15,1	7,1	3,8
		X _{0,3} X _{0,5} X _{1,0} (m)				>30 >30 15,5	>30 20,8 10,4	25,5 15,3 7,6
		ΔP _t (Pa)				113	26	6
		L _{WA} - dB(A)				38	23	<15
1500	416,7	V _k (m/s)				22,6	10,7	5,8
		X _{0,3} X _{0,5} X _{1,0} (m)				>30 >30 23,3	>30 >30 15,6	>30 22,9 11,5
		ΔP _t (Pa)				255	58	13
		L _{WA} - dB(A)				50	35	17
2000	555,6	V _k (m/s)					14,2	7,7
		X _{0,3} X _{0,5} X _{1,0} (m)					>30 >30 20,8	>30 >30 15,3
		ΔP _t (Pa)					103	23
		L _{WA} - dB(A)					44	25
2500	694,4	V _k (m/s)					17,8	9,6
		X _{0,3} X _{0,5} X _{1,0} (m)					>30 >30 26,0	>30 >30 19,1
		ΔP _t (Pa)					161	35
		L _{WA} - dB(A)					50	32
3000	833,3	V _k (m/s)						11,5
		X _{0,3} X _{0,5} X _{1,0} (m)						>30 >30 22,9
		ΔP _t (Pa)						51
		L _{WA} - dB(A)						37
3500	972,2	V _k (m/s)						13,4
		X _{0,3} X _{0,5} X _{1,0} (m)						>30 >30 26,7
		ΔP _t (Pa)						69
		L _{WA} - dB(A)						42
4000	1111,1	V _k (m/s)						15,3
		X _{0,3} X _{0,5} X _{1,0} (m)						>30 >30 >30
		ΔP _t (Pa)						90
		L _{WA} - dB(A)						46

Notes

- This selection table is based on laboratory tests as per ISO 5219 (UNE 100.710) and ISO 5135 and 3741.
- ΔT is equal to 0°C (isothermal air).
- The behaviour of the air jet with different Δt is shown in the following charts.


Symbols

- Q = Air flow
- V_k = Effective velocity
- A_k = Effective area
- ΔP_t = Total pressure drop
- L_{WA} = Sound power
- X_{0,3} - X_{0,5} - X_{1,0} = Throw for a terminal air velocity of 0.3, 0.5 and 1.0 m/s, respectively.

DF-49 model


Selection charts

DF-49-1.- Maximum vertical penetration.

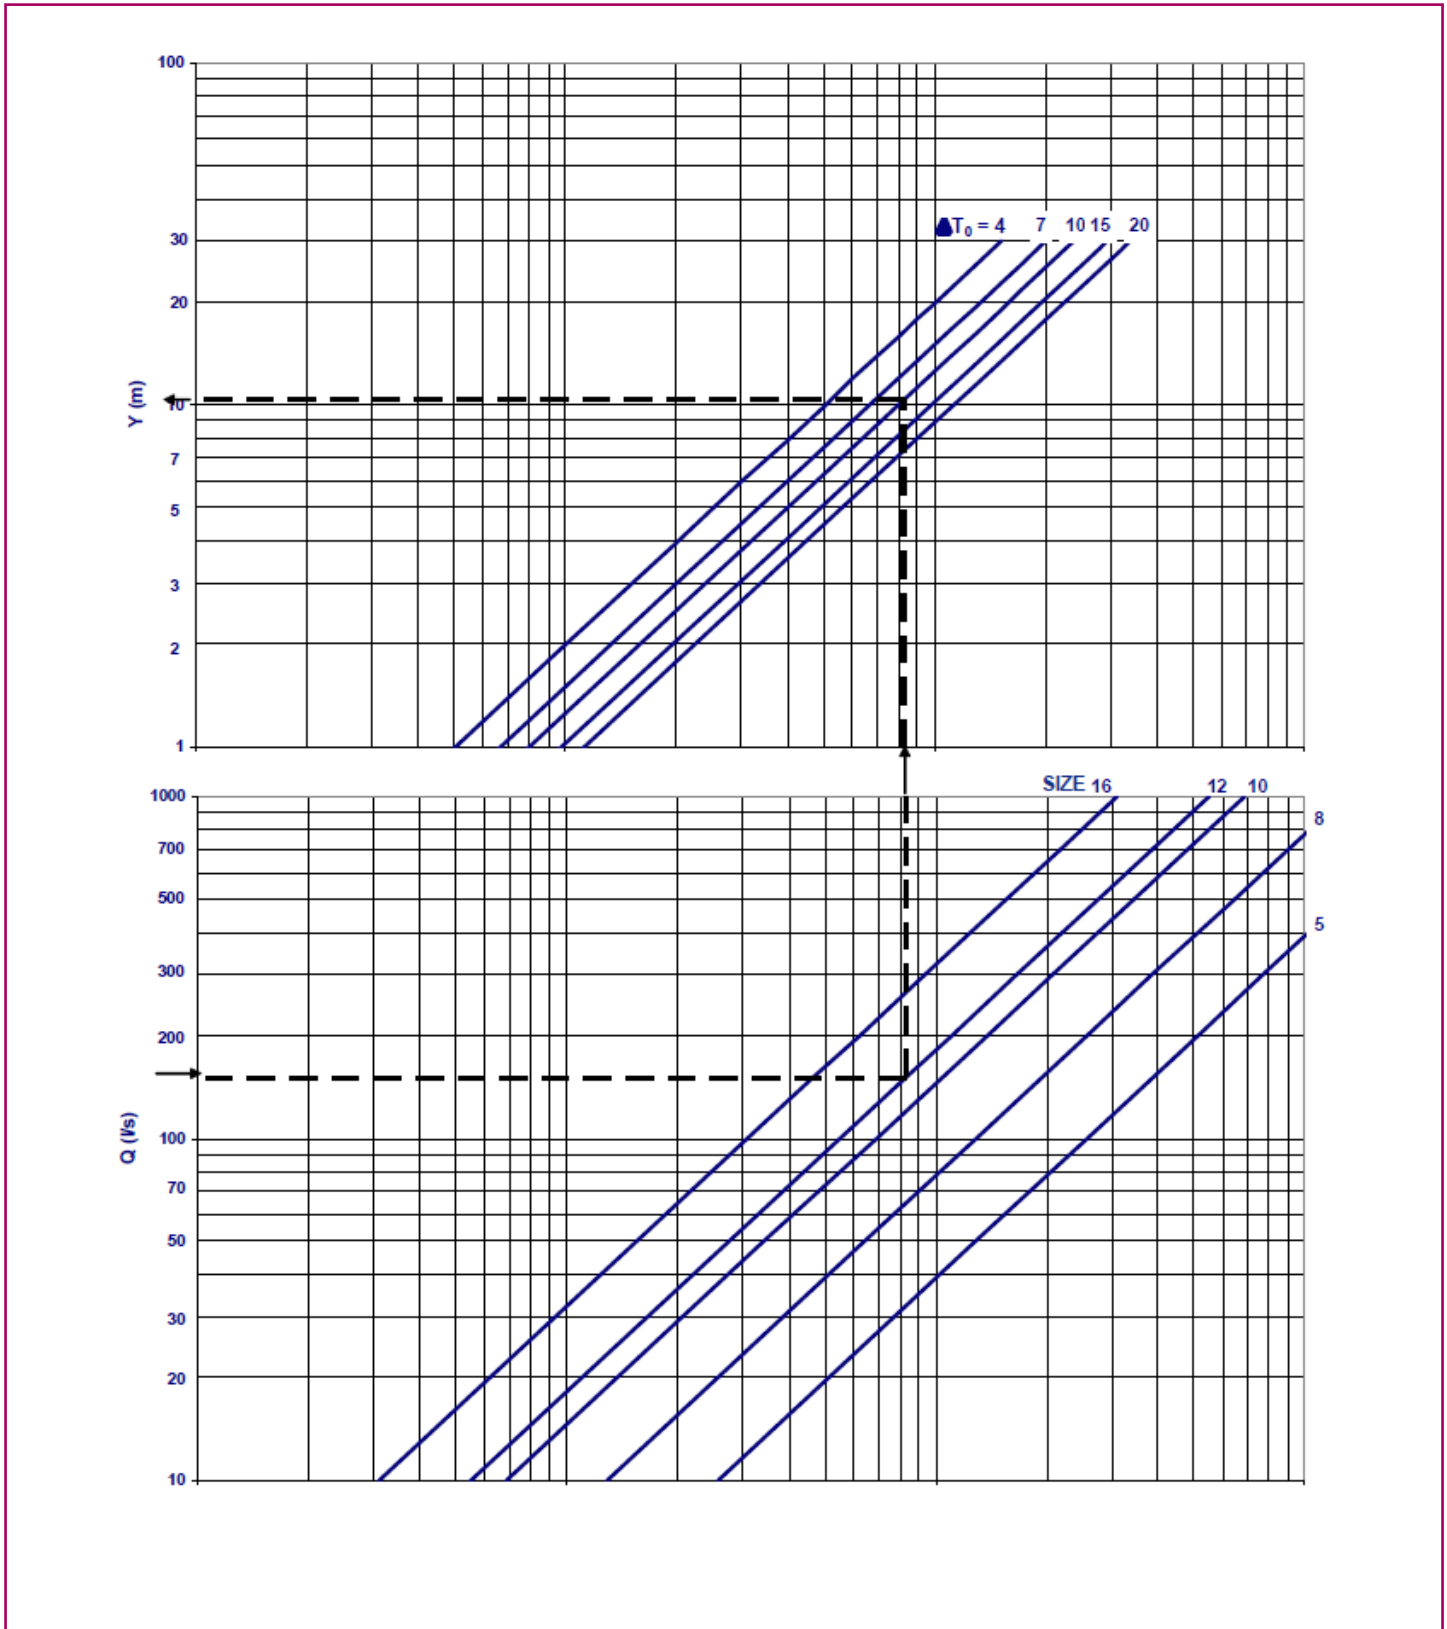


DF-49 model

DF-49-2.- Velocity of the air jet for the throw.

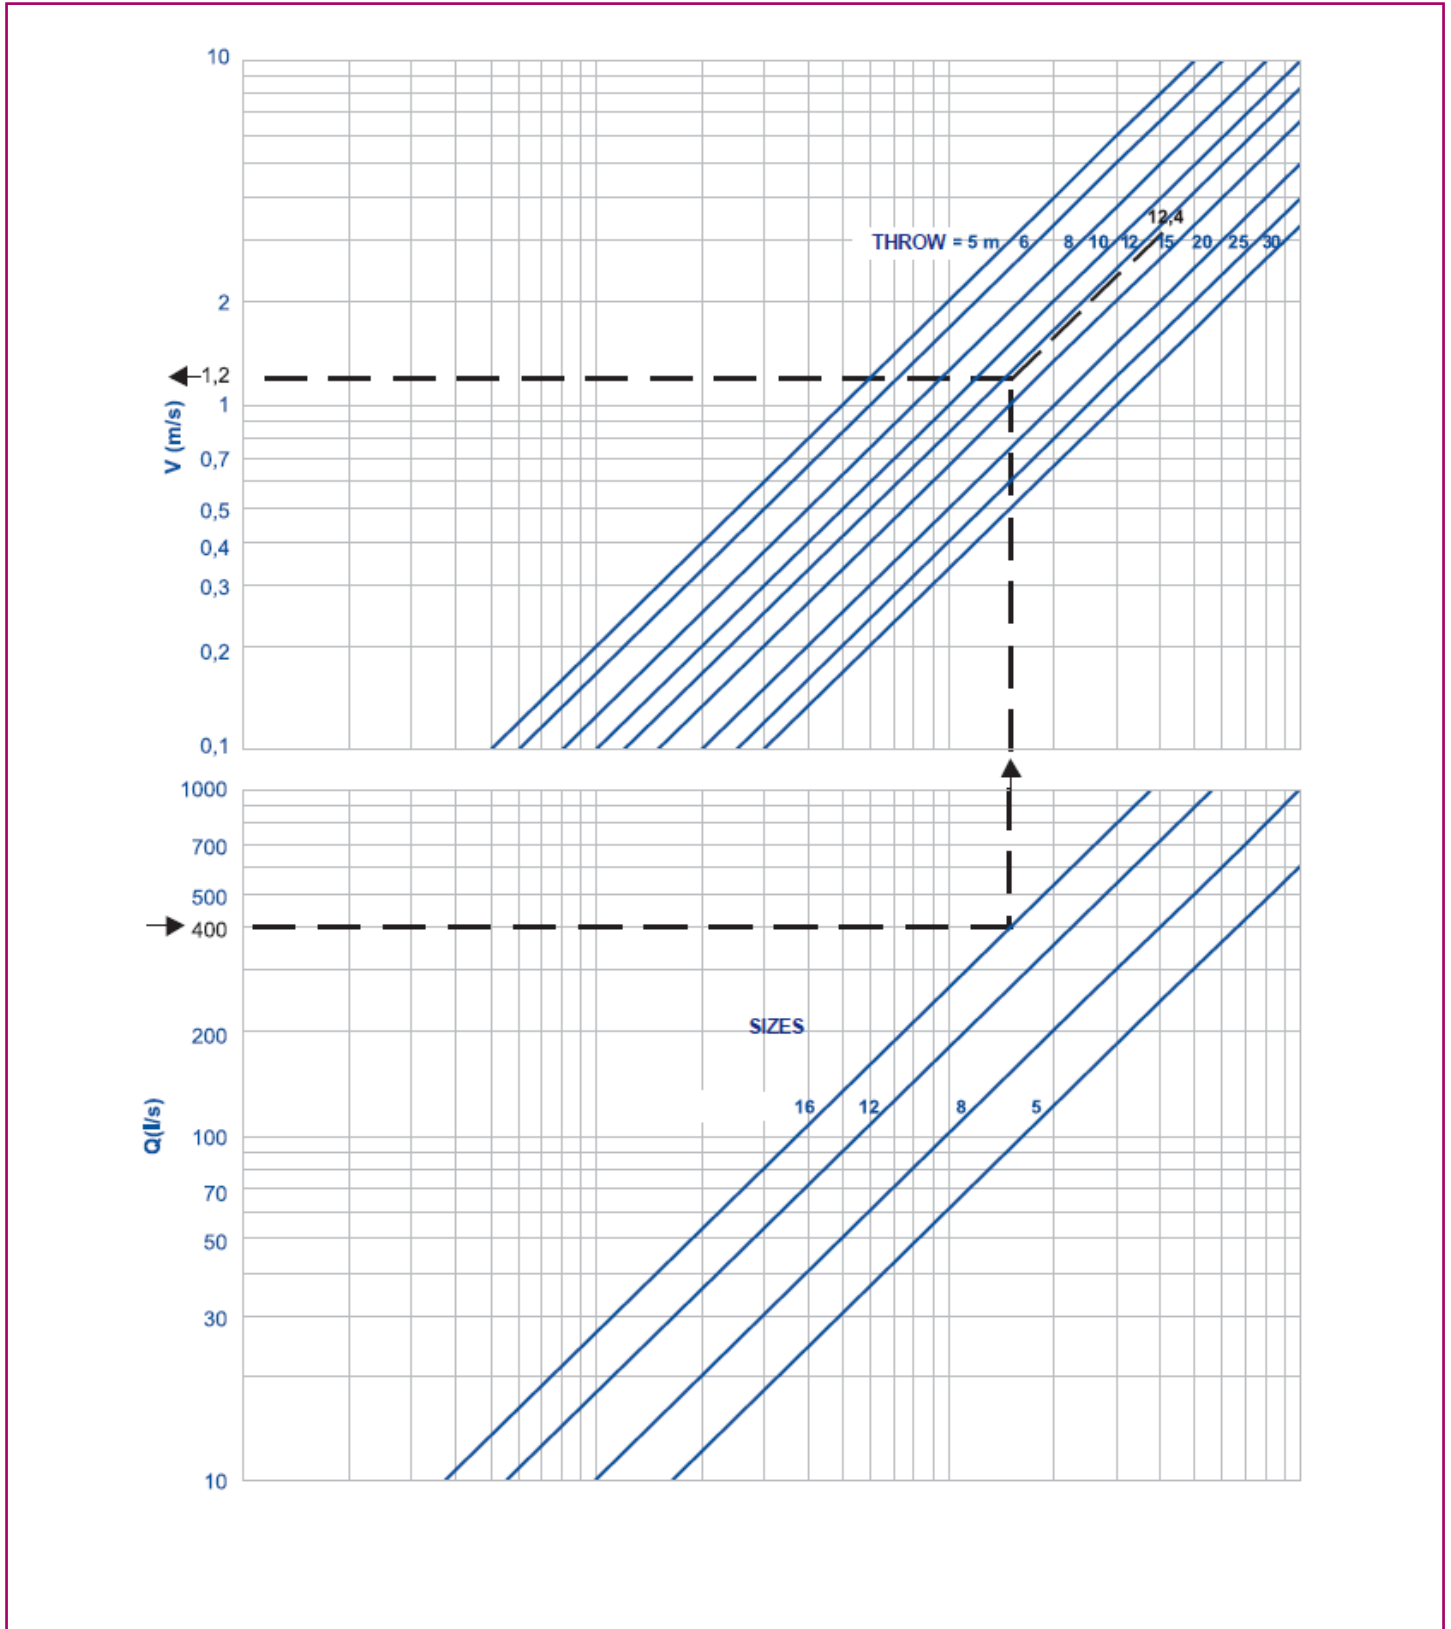


DF-49 model

DF-49-3.1.- Vertical deviation of the air jet (non-isothermal jets).

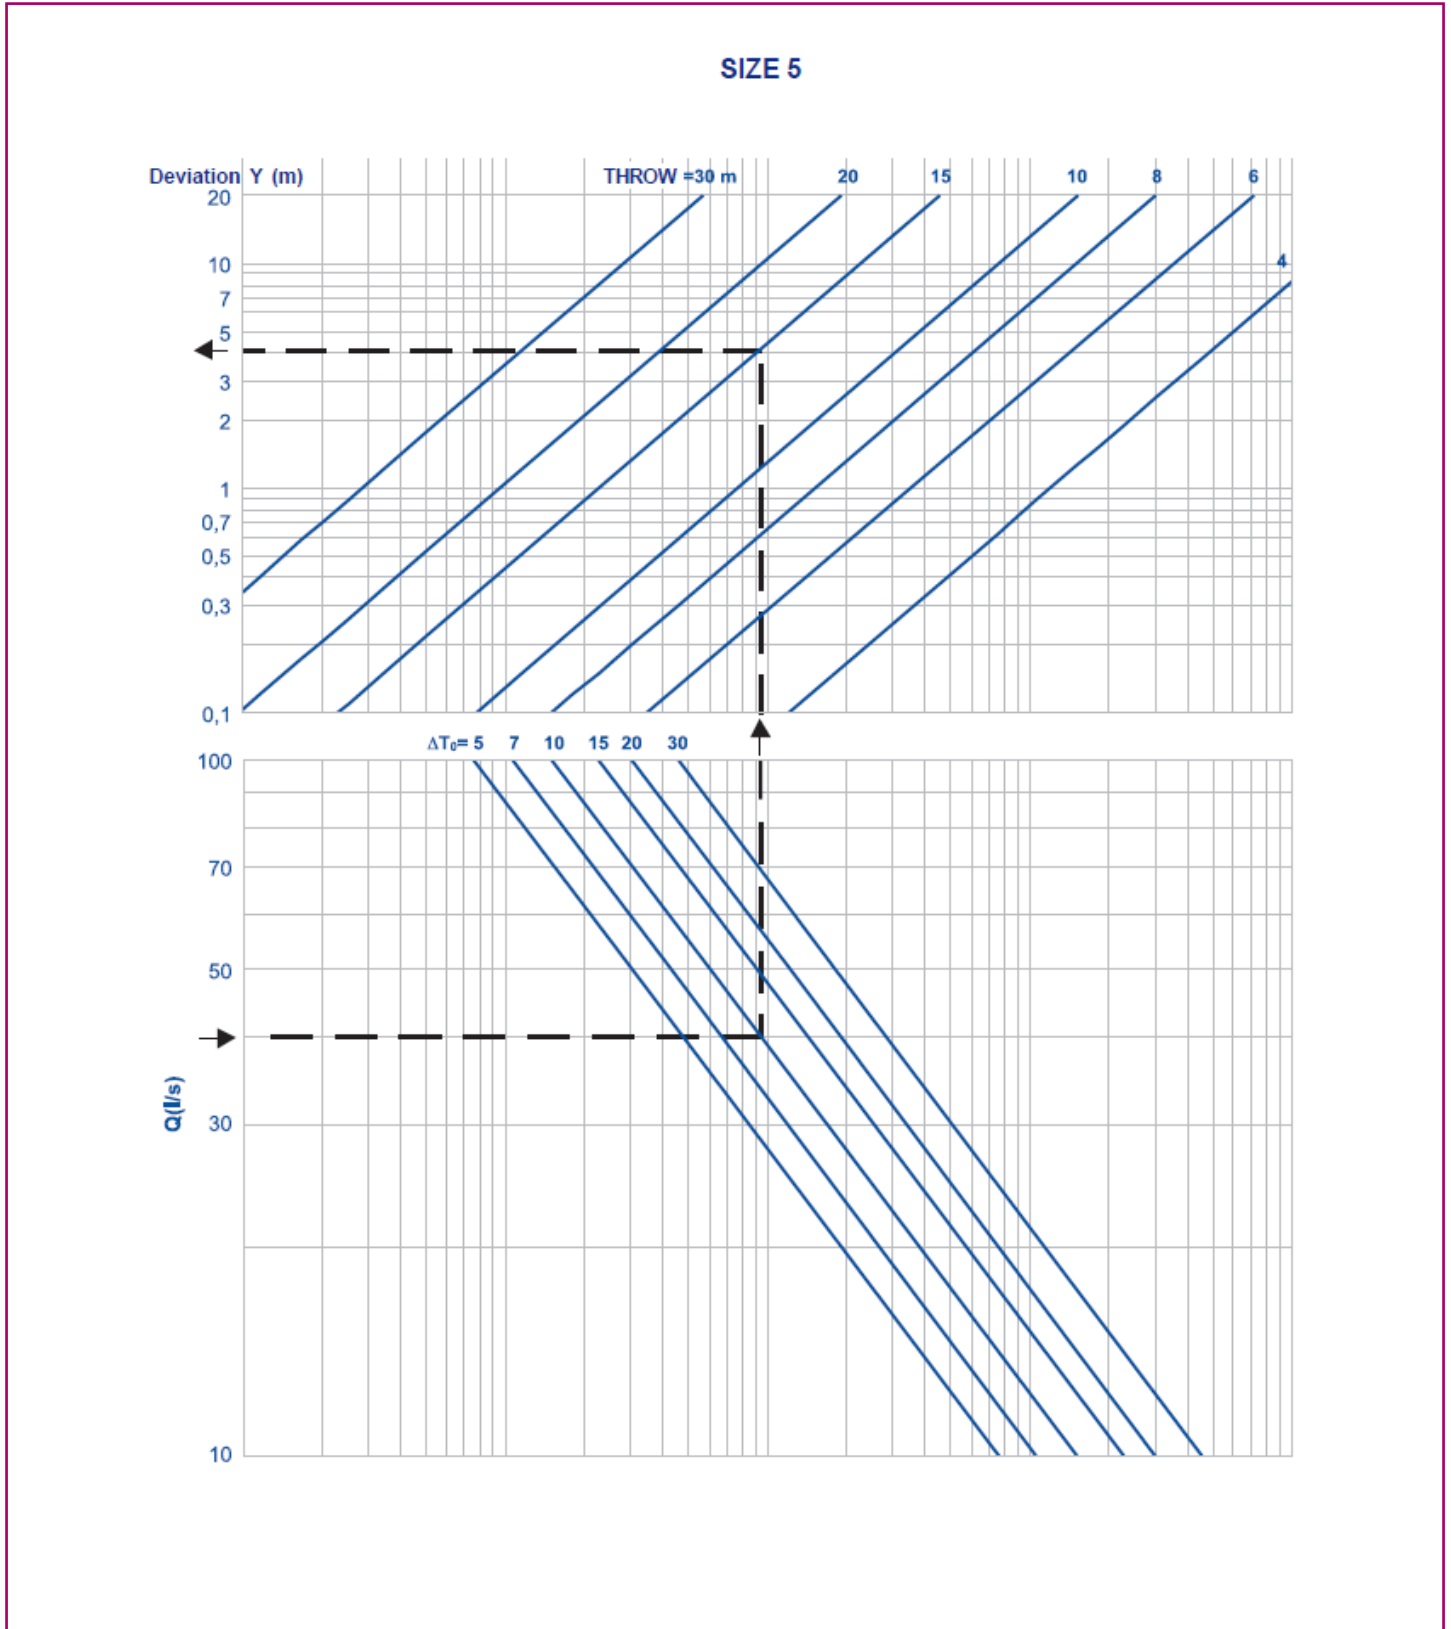


DF-49 model

DF-49-3. 2.- Vertical deviation of the air jet (non-isothermal jets).

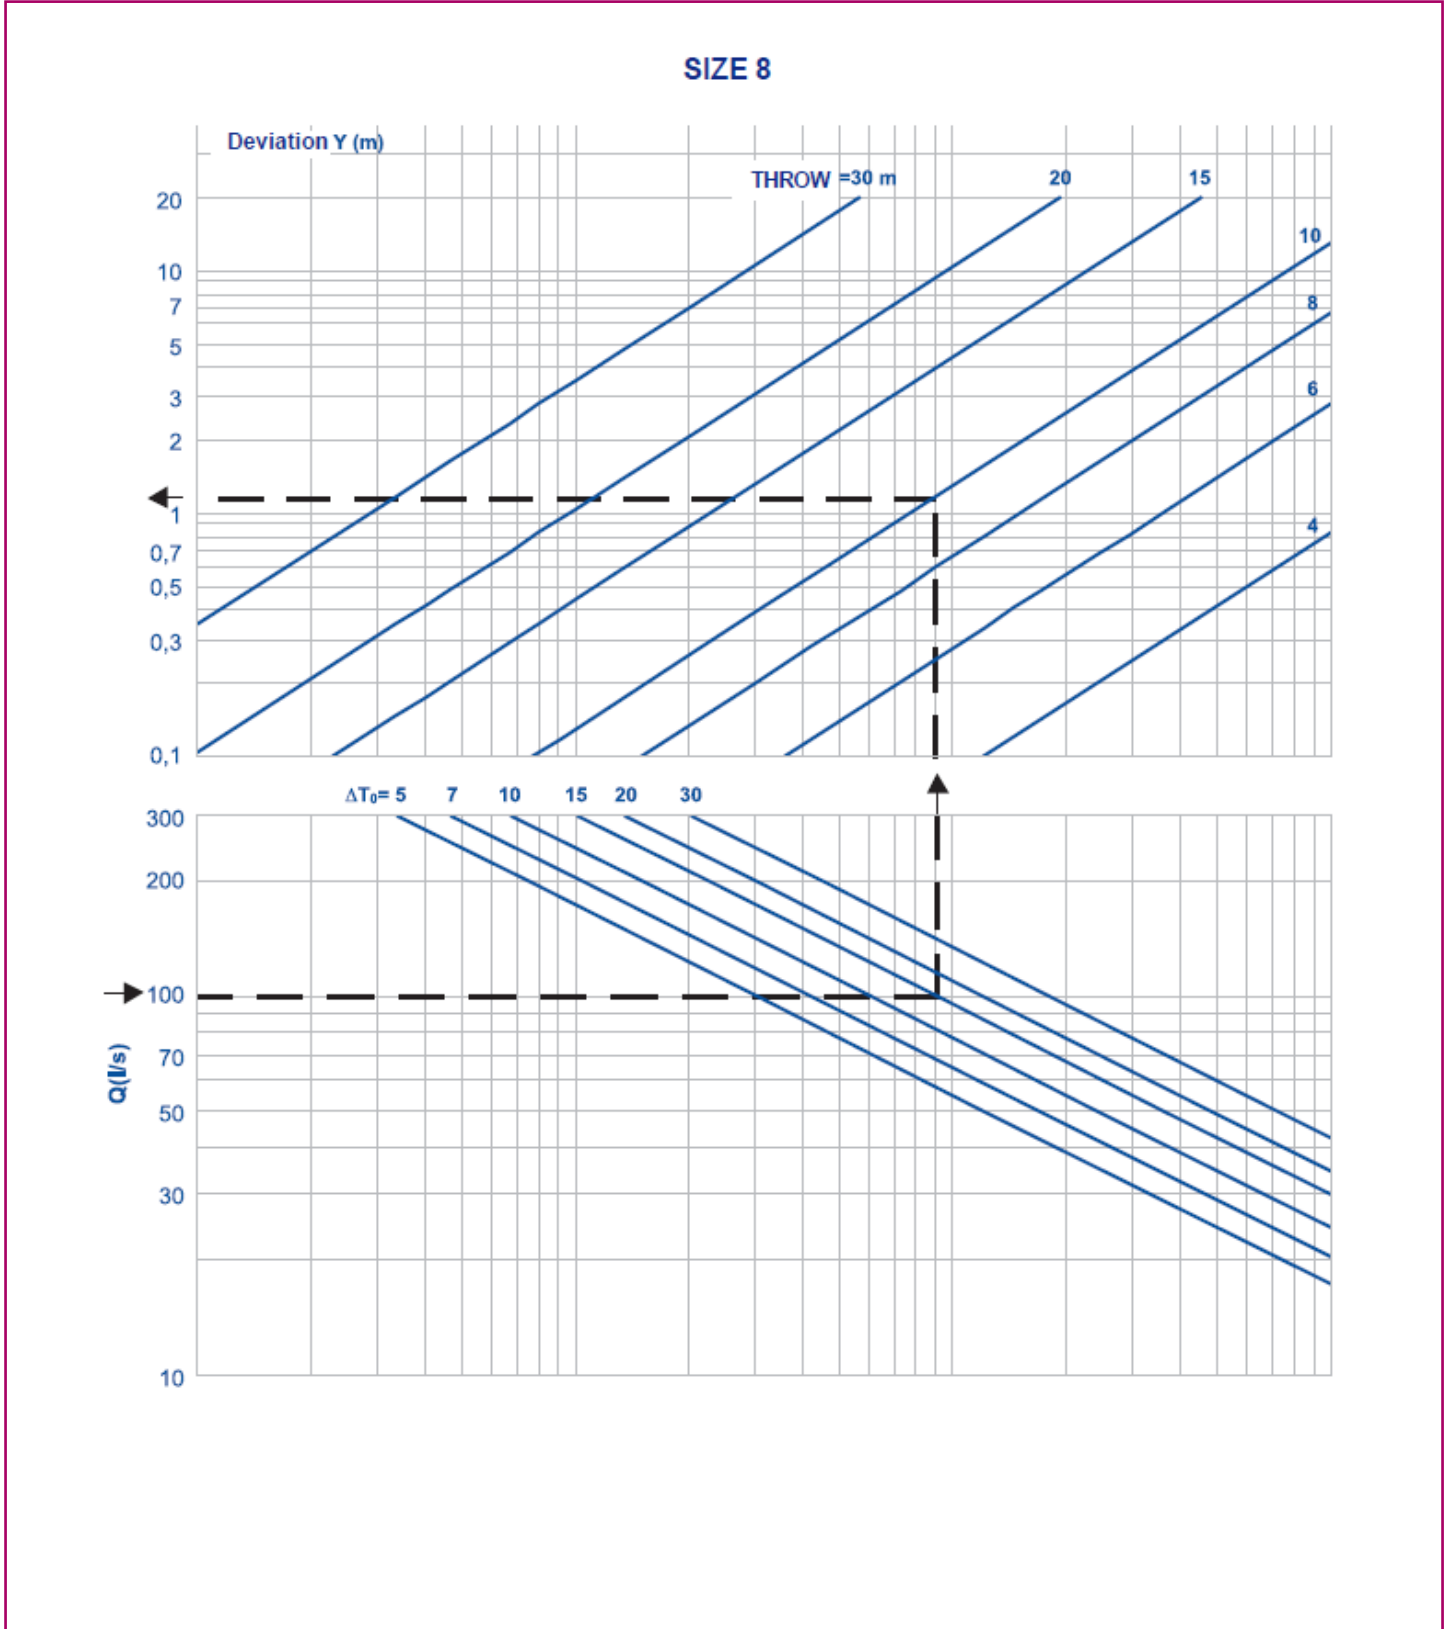


DF-49 model

DF-49-3. 3.- Vertical deviation of the air jet (non-isothermal jets).

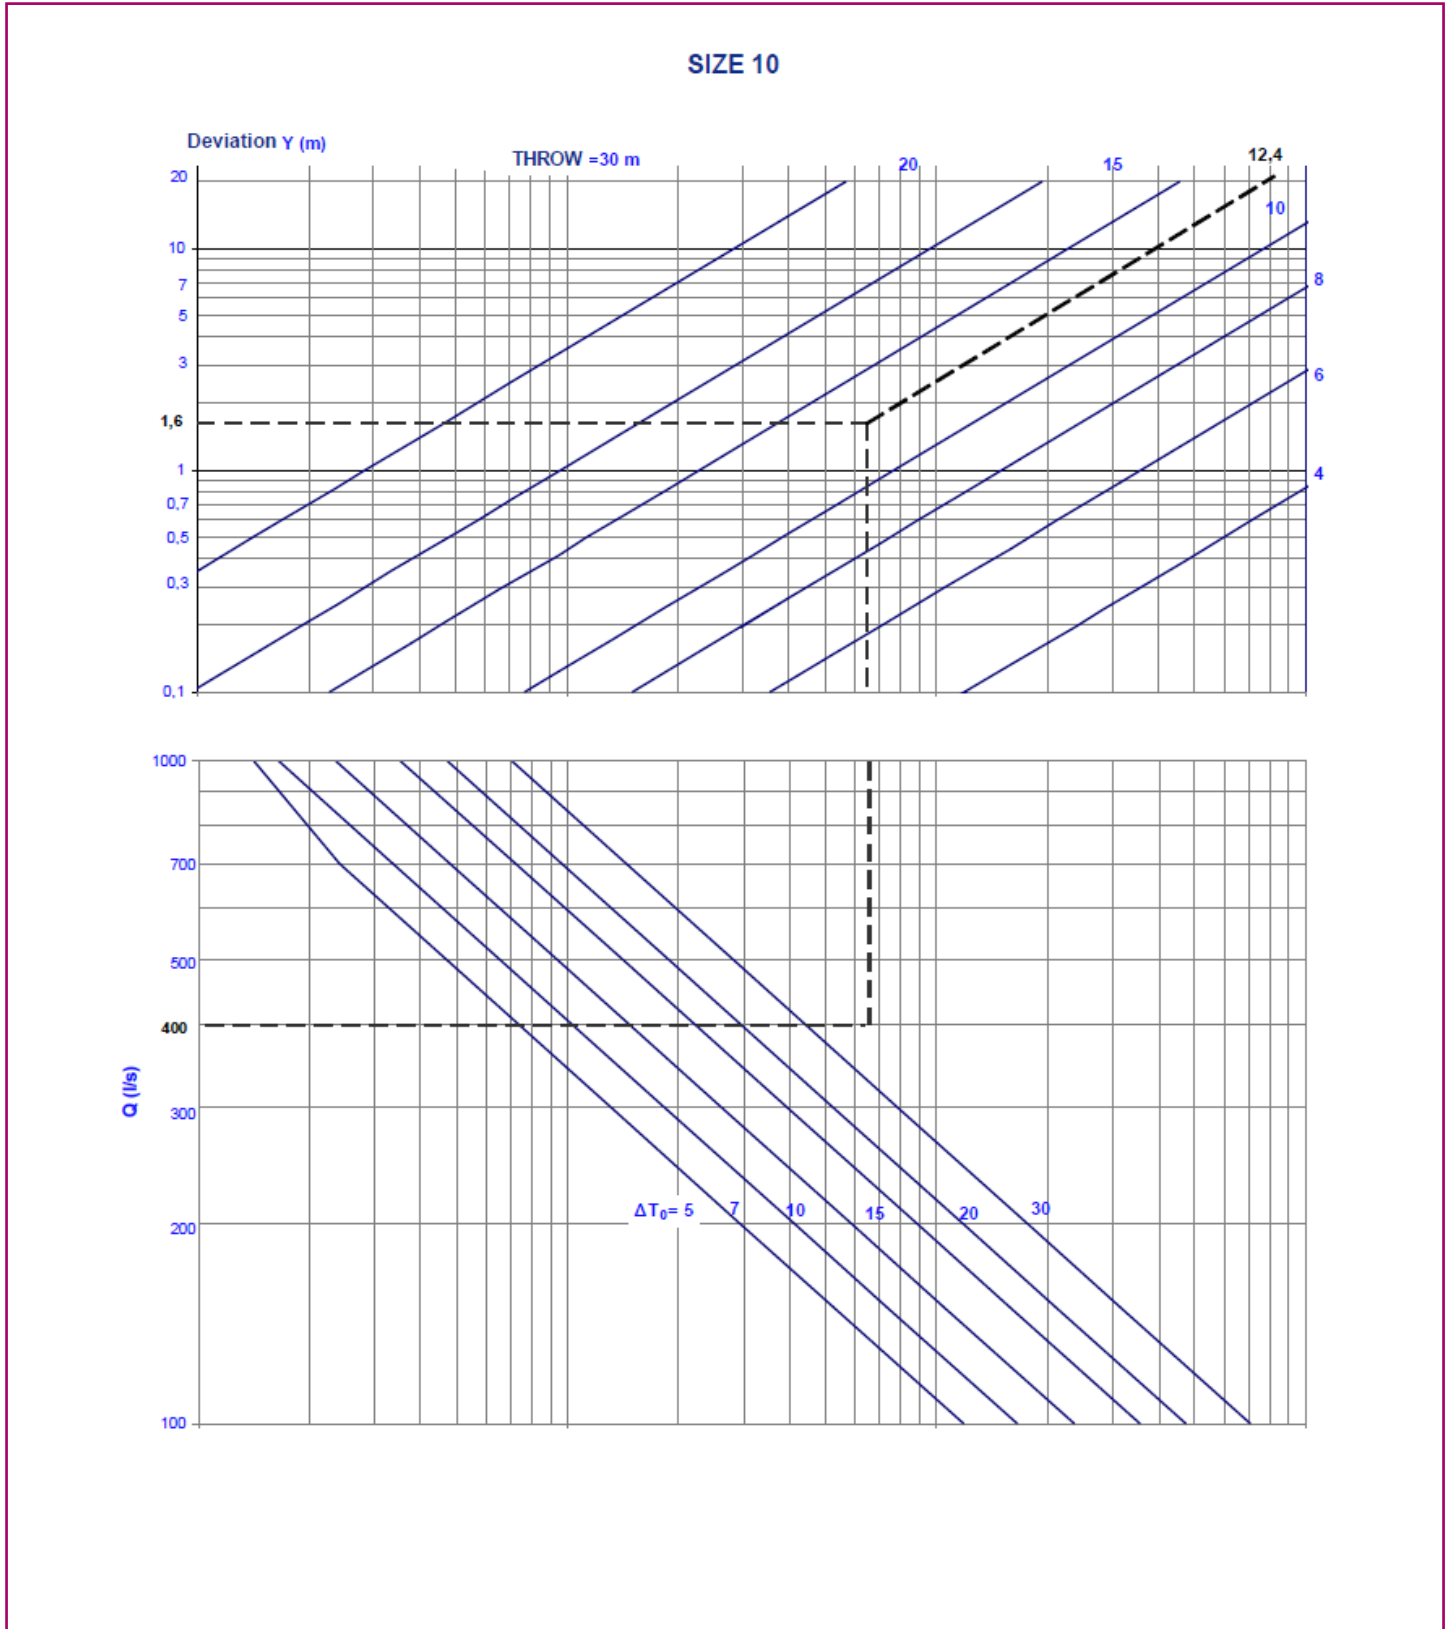


DF-49 model

DF-49-3. 3.- Vertical deviation of the air jet (non-isothermal jets).

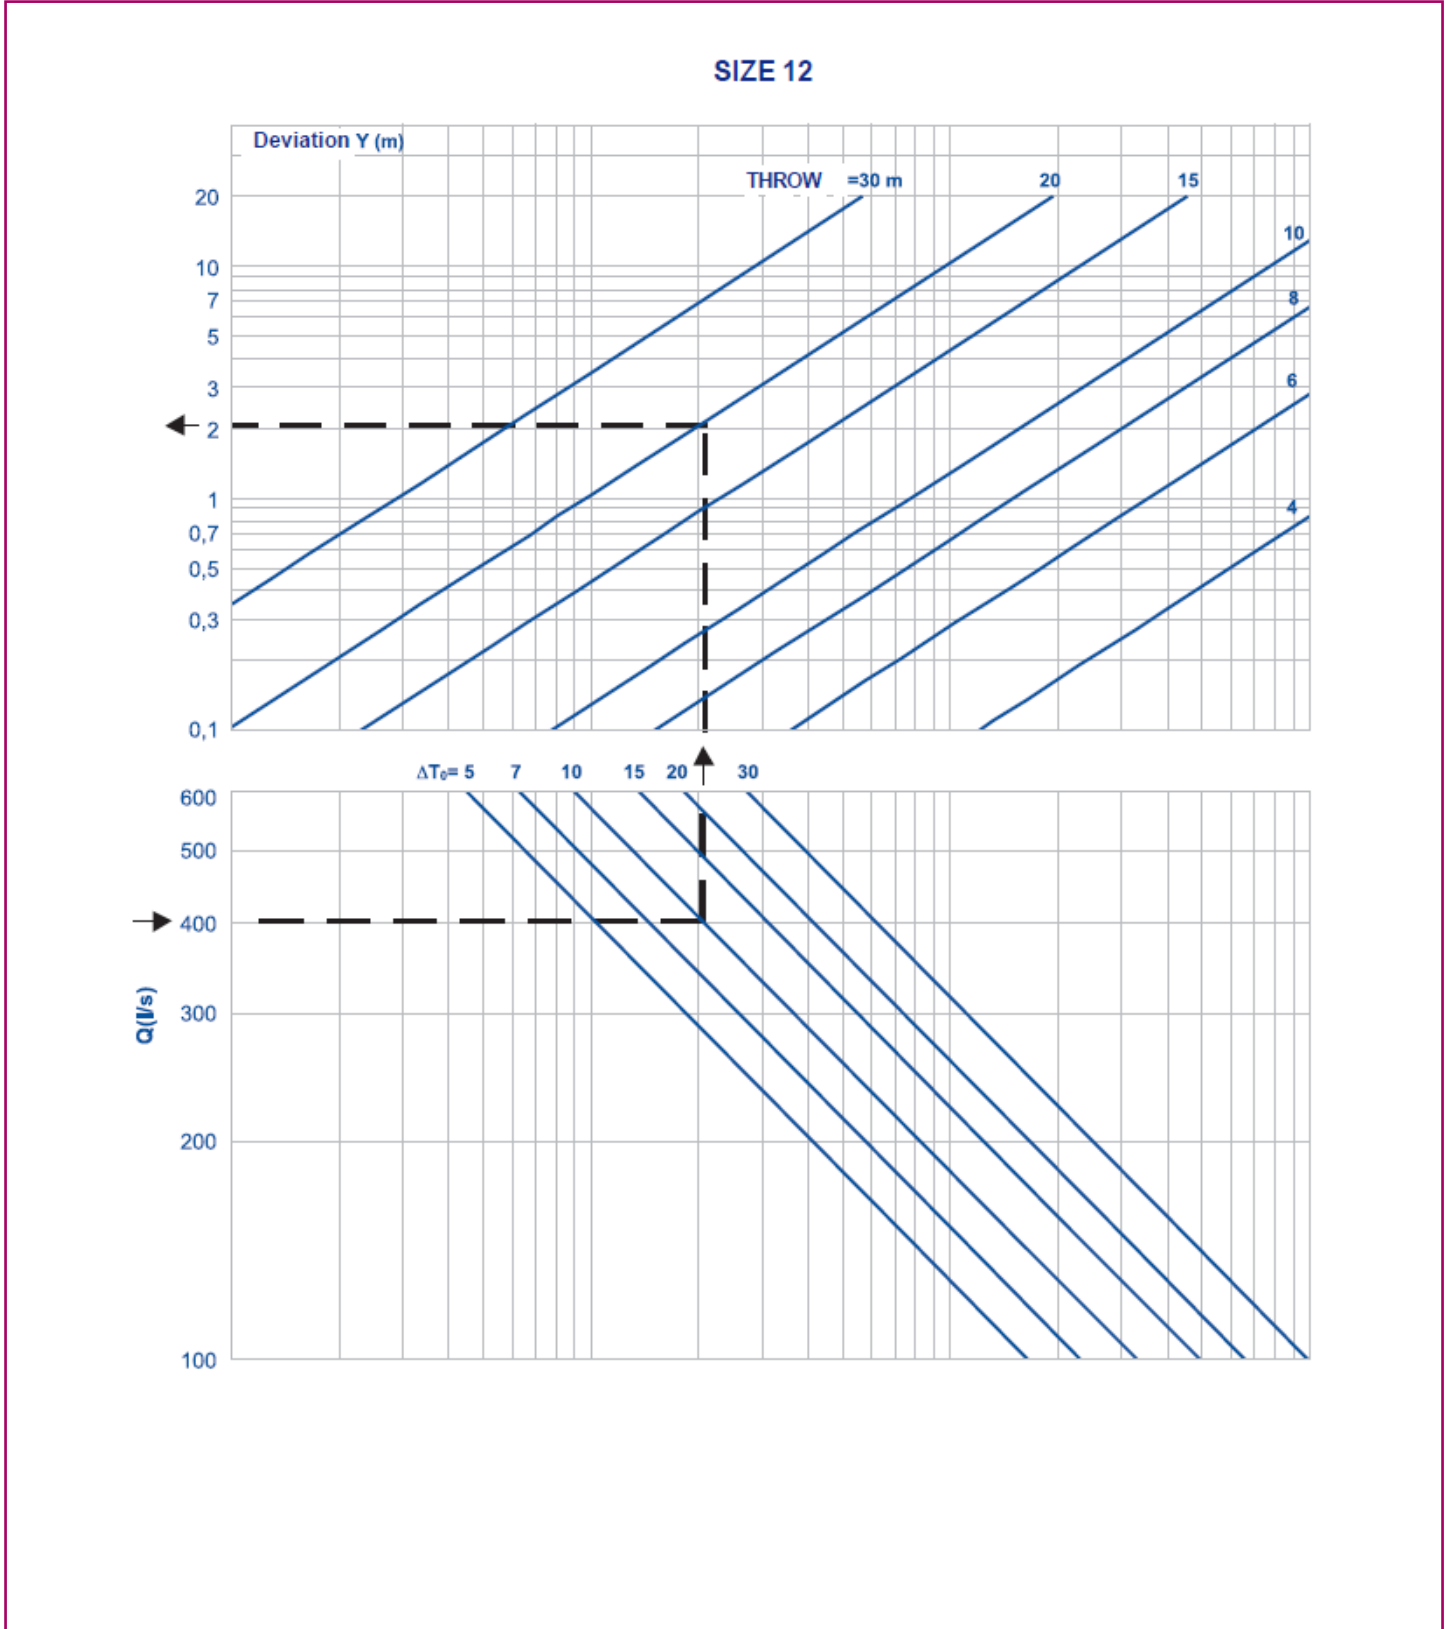


DF-49 model

DF-49-3. 4.- Vertical deviation of the air jet (non-isothermal jets).

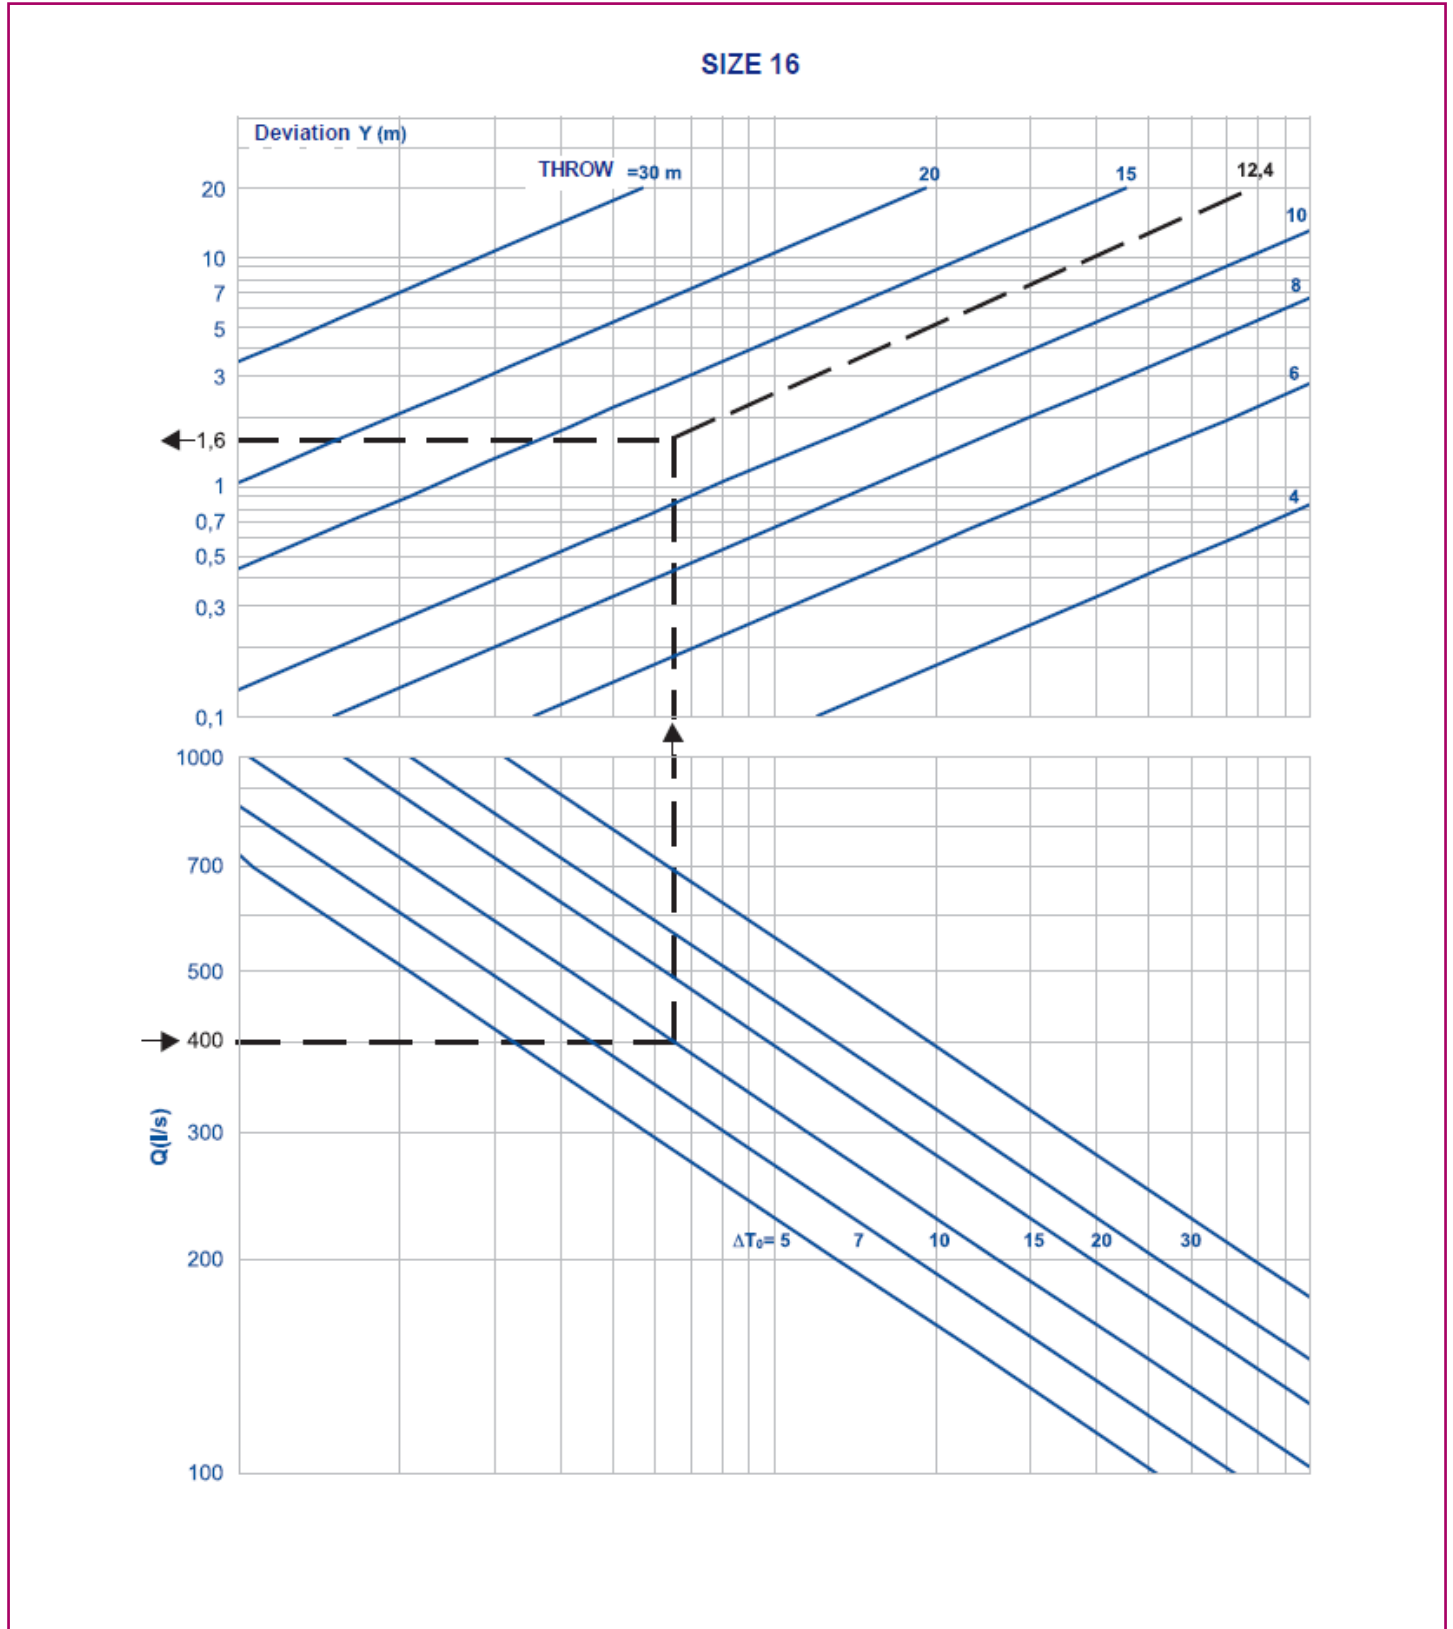


DF-49 model

DF-49-4.- Ratio between air flow velocities.

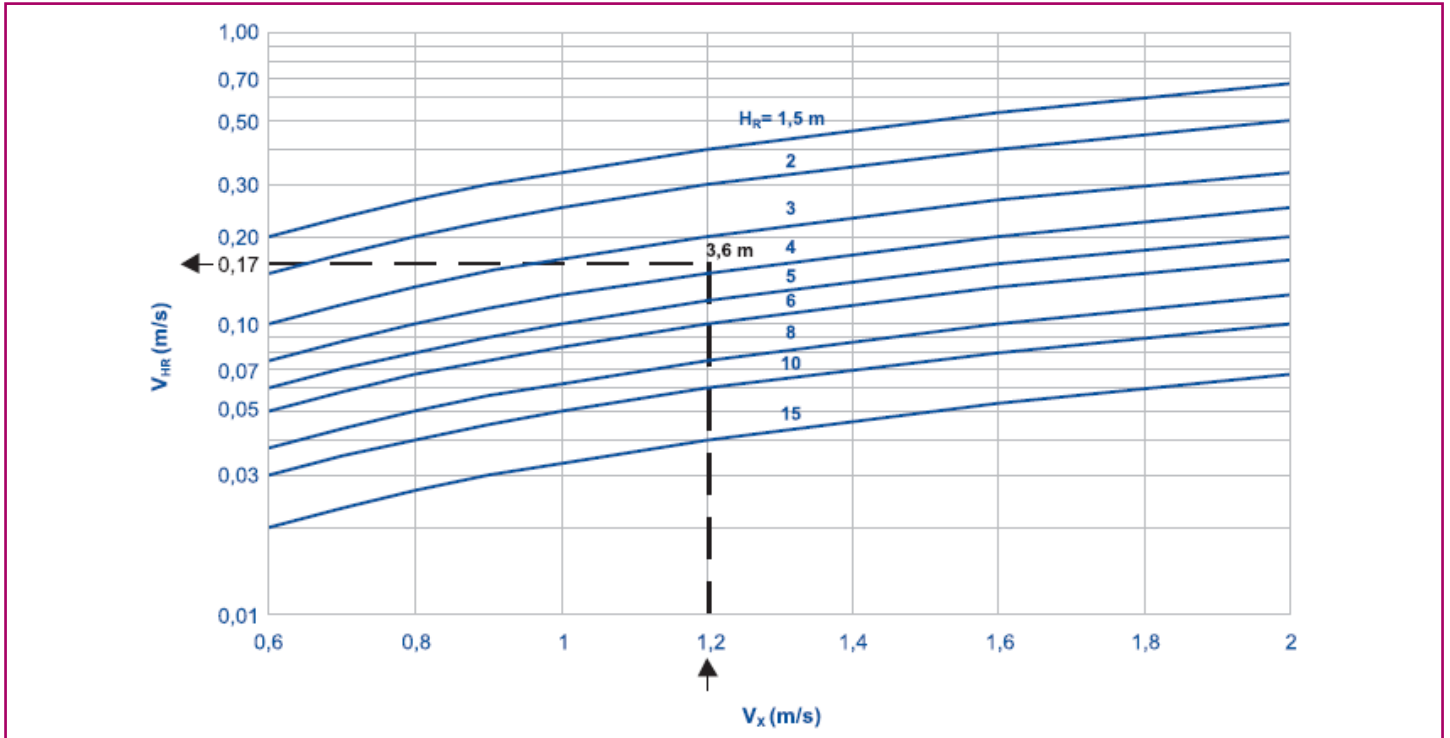


DF-49-5.- Ratio between temperature differences.

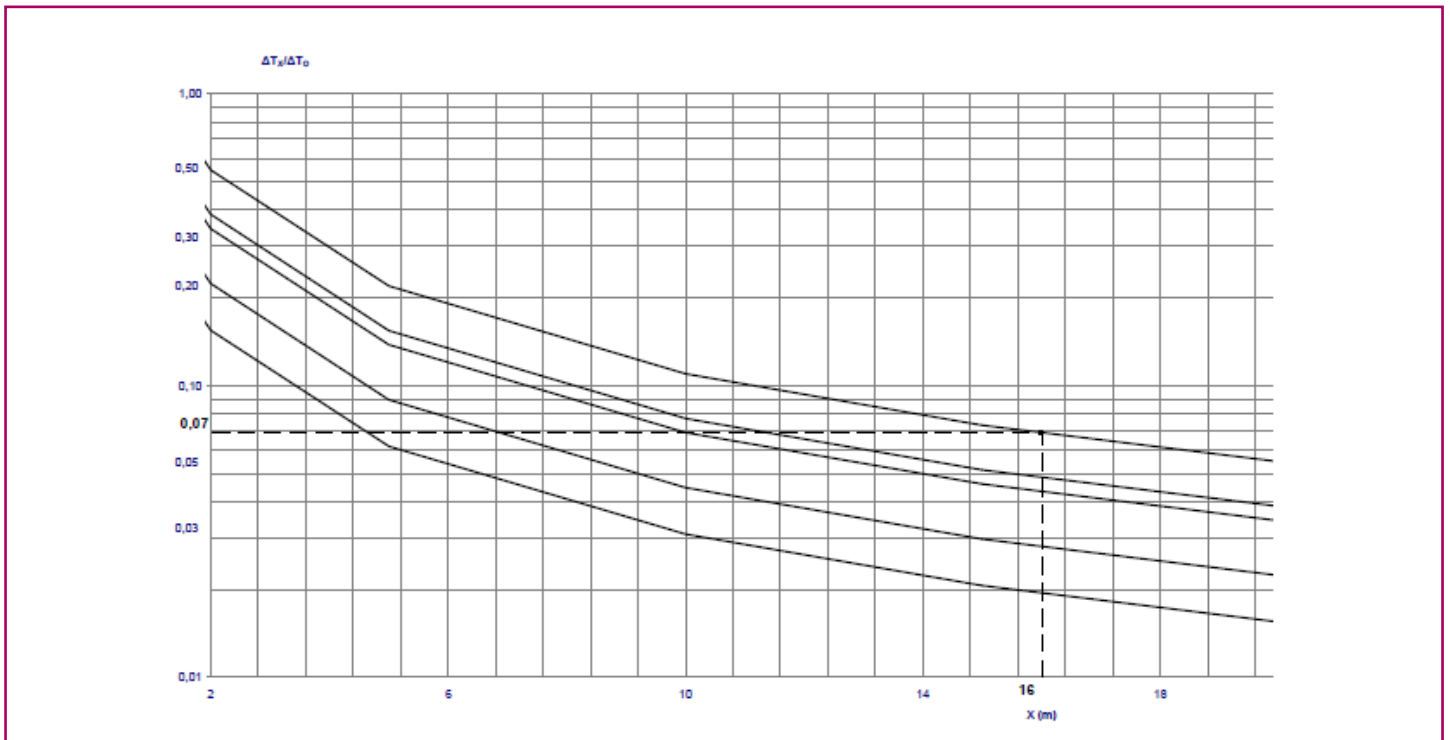


DF-49 model

DF-49-6.- Induction rate.

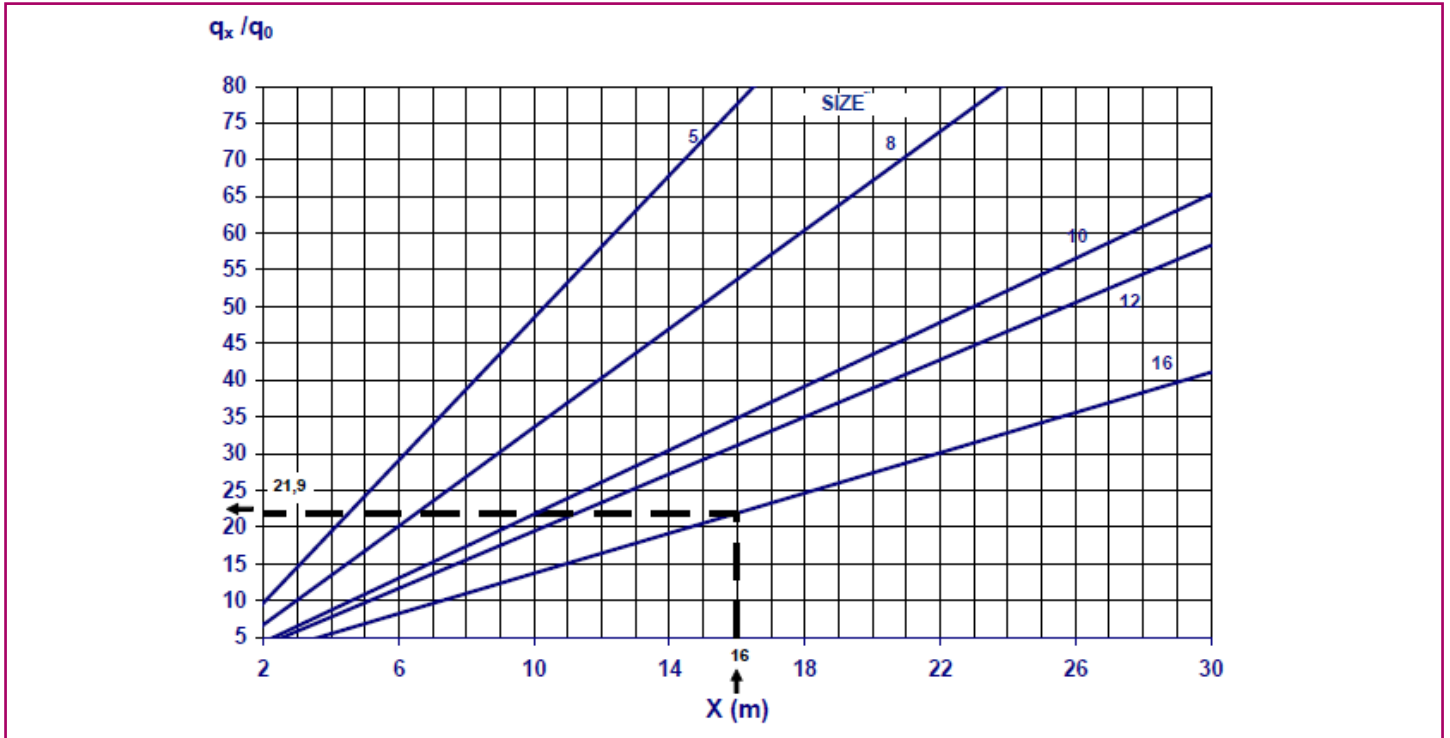

DF-49-7.- Pressure drop and sound power level.

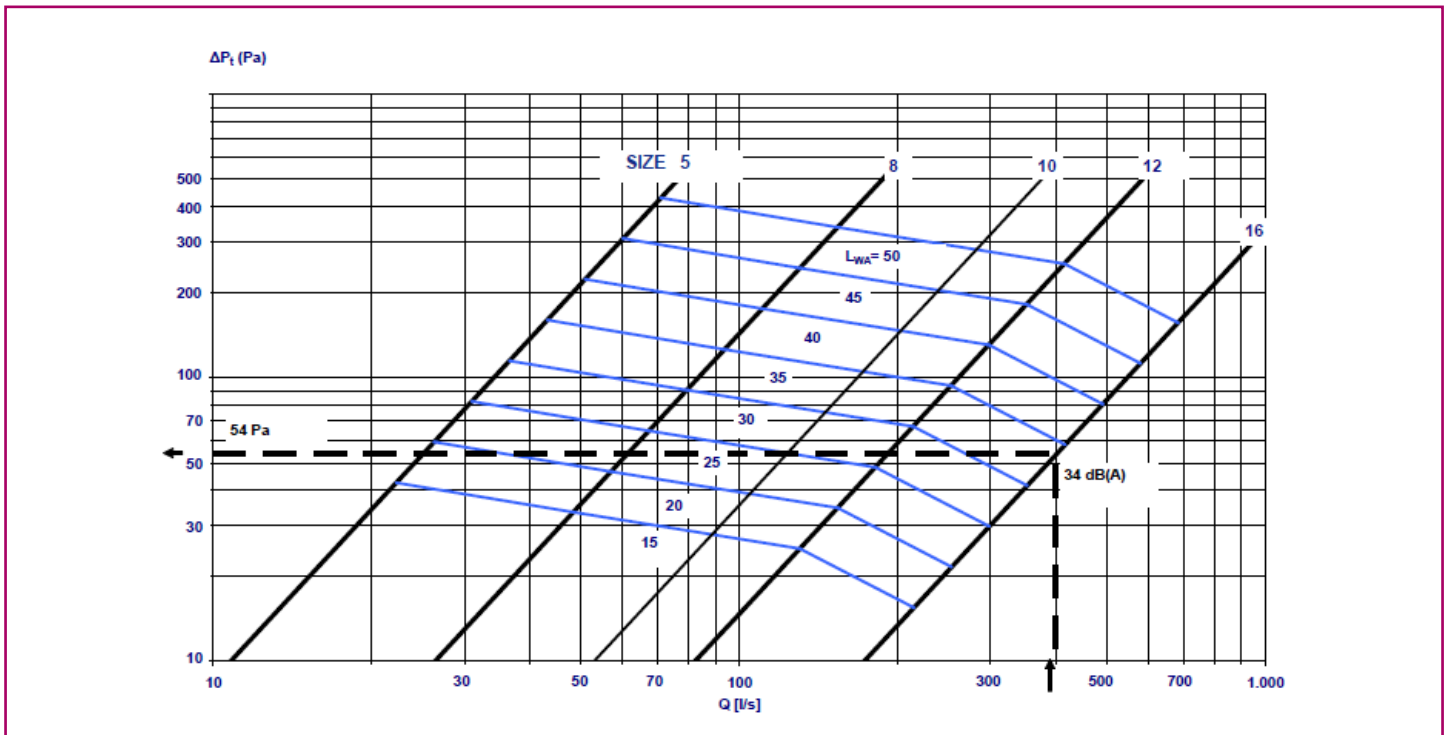

Selection in a sample project

Initial data

Two DF-49 nozzles are located, one in front of the other at a distance of 24 m, with the following starting data based on the sketch attached in the Symbols section on page 16.

- L = 12 m
- H = 4 m (height from floor)
- $Q_{\text{nozzle}} = 400 \text{ l/s}$
- Supply temperature = 15° C
- Room temperature = 25° C
- $\Delta T_0 = -10^\circ \text{ C}$
- $H_H = 2 \text{ m}$ (height of occupied area)

The diffuser should be selected to obtain the following:

- Maximum velocity in the occupied area: 0,2 m/s.
- The vertical temperature gradient must not exceed 3 °C.
- The sound power level of the selected equipment must not exceed 40 dB(A).

Selection

- DF-49 quick selection table (page 4)

Based on the sound power limit, size 16 is preselected.

- DF-49-7 chart (page 13)

Using size 16 for 400 l/s, the following values are obtained:

- $\Delta P_t = 54 \text{ Pa}$ (pressure drop)

- $L_{WA} = 34 \text{ dB(A)}$ (sound power level)

- DF-49-2 chart (page 6)

For a supply angle of $\alpha_x = +15^\circ$ C,

The throw will be $l = L / \cos 15^\circ = 12 / 0,966 = 12,42 \text{ m}$

According to the chart, the velocity for this throw is $V_x = 1,2 \text{ m/s}$

- DF-49-3.4 chart (page 11)

The impact point under isothermal conditions would be $H + H_C = H + (L \times \tan 15^\circ) = 4 + (12 \times 0,268) = 7,2 \text{ m}$

The chart indicates that for $\Delta T_0 = -10^\circ \text{ C}$, throw: 12,42 m and Q: 400 l/s the vertical deviation is $Y = 1,6 \text{ m}$, as the air jet is non-isothermal.

Therefore, the air jets have an impact point situation at a height from the floor of: $7,2 - 1,6 = 5,6 \text{ m}$.

- DF-49-4 chart (page 12)

For a height $H_R = 5,6 - 2 = 3,6 \text{ m}$, entering with $V_x = 1,2 \text{ m/s}$ gives a velocity of $V_{HR} = V_H = 0,17 \text{ m/s}$ in the occupied area.

- DF-49-6 chart (page 13)

For a throw of $l + H_R = 12,42 + 3,6 = 16,02$ we have $q_x / q_o = 21,9$.

- DF-49-5 chart (page 12)

For a throw of $l + H_R = 12,42 + 3,6 = 16,02$ we have $\Delta T_X / \Delta T_0 = 0,07$.


Therefore, the temperature of the air jet at its inlet in the occupied zone will be:

$$\Delta T_X = T_X - T_{\text{Temperature}} \quad T_X = T_{\text{Temperature}} + \Delta T_X = 25 + [0,07 \times (-10)] \quad T_X = 24,3^\circ \text{ C}$$

Symbols

Common symbols used in all tables and charts in the catalogue.

l (m):	Distance between the equipment to the impact point of the jets (with another jet or wall) under isothermal conditions.
α_x (°):	Supply angle.
L (m):	Horizontal distance from the equipment to the impact point of the jets (with another jet or wall).
X (m):	Throw of the air jet.
Y (m):	Deviation of the air jet caused by a temperature difference between the supply and ambient air.
H (m):	Installation height of the equipment.
H_H (m):	Height of occupied area.
H_C (m):	Height from the impact point of the jets (with another jet or wall) under isothermal conditions with respect to the equipment location.
H_I (m):	Height from the impact point of the jets (with another jet or wall) under isothermal conditions.
H_R (m):	Height from impact point of the jets (with another jet or wall) with respect to the point where the air velocity and temperature are to be determined (generally the occupied area).
Q (m ³ /h ó l/s):	Supply air flow.
A_K (m ²):	Effective area.
V_X (m/s):	Velocity of the jets at throw X .
V_H (m/s):	Velocity of the jets in the occupied area.
V_K (m/s):	Effective supply velocity.
V_{HR} (m/s):	Velocity of the jets at a distance, HR , below the impact point of the jets (with another jet or wall).
ΔT_O (°C):	Temperature difference between the supply jets and room air.
ΔT_X (°C):	Temperature difference between the jets (for throw X) and room air.
ΔT_h (°C):	Temperature difference between the jets (in occupied area) and room air.
q_x/q_o :	Induction rate. Quotient between the air flow for a throw X and the air flow supplied in the zone.
Y_{max} (m):	Maximum throw with vertical supply of hot air ($V_x=0$ m/s).
ΔP_i (Pa):	Total pressure drop.
L_{wA} [dB(A)]:	Sound power level.

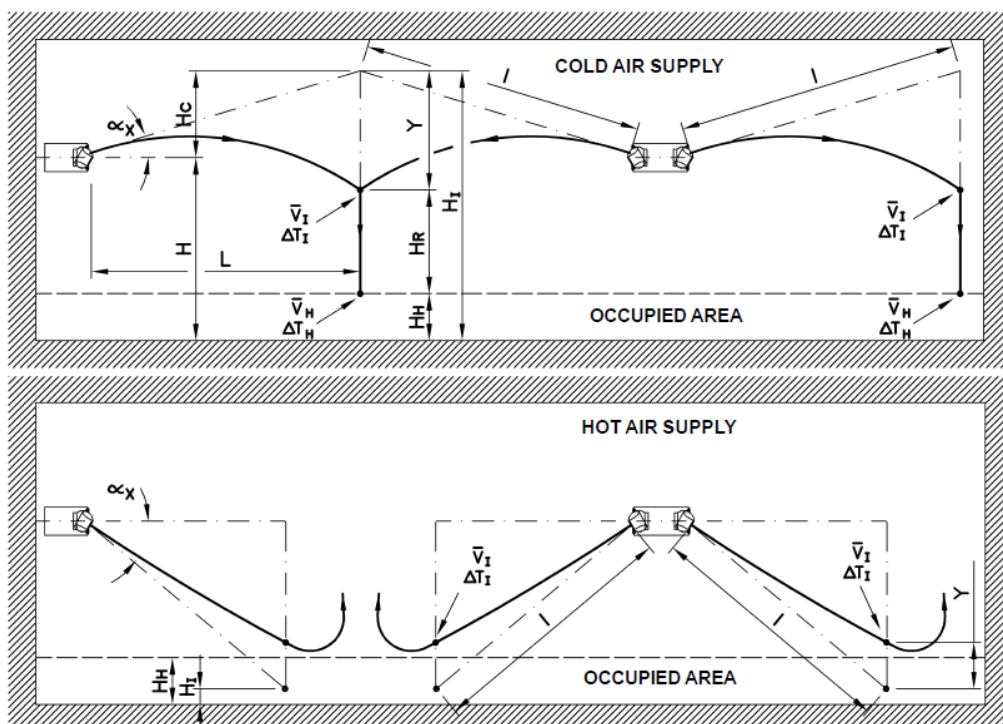

THIS CATALOGUE IS INTELLECTUAL PROPERTY.

Reproduction, either partial or total, by any means, including electronic, is prohibited without prior written authorisation from KOOLAIR, S.L.



KOOLAIR

KOOLAIR, S.L.

Calle Urano, 26

Poligono industrial nº 2 – La Fuensanta

28936 Móstoles - Madrid - (España)

Tel: +34 91 645 00 33

Fax: +34 91 645 69 62

e-mail: info@koolair.com

www.koolair.com